

DESCRIPTION	
1	ISOLATION VALVES
2	Y STAINER
3	SAMSUNG ASHP
4	DHW HIGH STAT LIMIT
5	JOULE SMART PLUMB DHW/BUFFER CYLINDER
6	28 MM DHW 2 PORT ZONE VALVE
7	HEAT EXPANSION VESSEL
8	28 MM BUFFER 2 PORT ZONE VALVE
9	PRIMARY PUMP FLOW
10	SAMSUNG HEAT PUMP FLOW SWITCH
11	FLOW REGULATOR / FLUSH AND FILL UNIT
12	HEATING ZONE CIRCULATING PUMP
13a	22 MM 2 PORT ZONE VALVE HEATING ZONE 1
13b	22 MM 2 PORT ZONE VALVE HEATING ZONE 2
13c	22 MM 2 PORT ZONE VALVE HEATING ZONE 3
14	DHW IMMERSION
15	FLEXIBLE HOSE

**SAMSUNG ASHP WITH SMARTPLUMB DHW WITH 3 HEATING ZONE 3XRADs**

**Front View of Unit & Cylinder**

## NOTES

### POWER SUPPLY

- All electrical wiring must be carried out by a competent installer and be installed in accordance with current local Wiring Regulations.

### PROTECTIVE EARTH

- All pre-installed components are earthed. The integrity of a protective earth system relies on its primary connection. It is the installers responsibility to ensure the rear of the MIM casing is earthed, therefore providing a protective earth connection to all system components.

### COMMUNICATION CABLE


- The communication cable carries the signal between the outdoor unit and the MIM casing.
- Use a two-core cable connect the terminals F1 & F2 of the outdoor unit to the terminals F1 & F2 of the MIM casing.

### FLOW SENSOR

- The flow sensor is a 4 pin push fit connector that connects to the MIM casing on the connection labelled 'CNS057'.
- The flow sensor cable is 2 meters in length. This can be extended however it is essential that the inner cable core colours are matched end to end.


### IMPORTANT

- Applying a 230V switched live to the terminal 'Zone 1' S/L will activate 'Heating Zone Valve 1'.
- All external controls are 230V AC Connections
- You should connect the power cable into the power cable terminal and fasten it with a clamp like shown below




- To protect the product from water and possible shock, you should keep the power cable and the connection cord of the control kit and outdoor units within ducts. (with appropriate IP rating and material selection for your application)
- Ensure that main supply connection is made through a switch that disconnects all poles, with contact gap of a least 3 mm.
- Devices disconnected from the power supply should be completely disconnected in the condition of overvoltage category.
- Keep distances of 50mm or more between power cable and communication cable.

ITEM NO.	DESCRIPTION
A	SAMSUNG 30 A ELCB
B	SMART PLUMB CYLINDER
C	SAMSUNG MIM-E03CN/DN
D	SAMSUNG FLOW SENSOR
E	SAMSUNG TOUCH SCREEN CONTROLLER
F	SAMSUNG OUTDOOR UNIT
G	JOULE KODIAK PCB
P1	WILO PRIMARY CIRCULATING PUMP
P2	WILO SECONDARY CIRCULATING PUMP
T	JOULE E91 ROOM THERMOSTAT
V1	DHW - 2 PORT ZONE VALVE
V2	BUFFER - 2 PORT ZONE VALVE
V3	HEATING ZONE 1 - 2 PORT ZONE VALVE

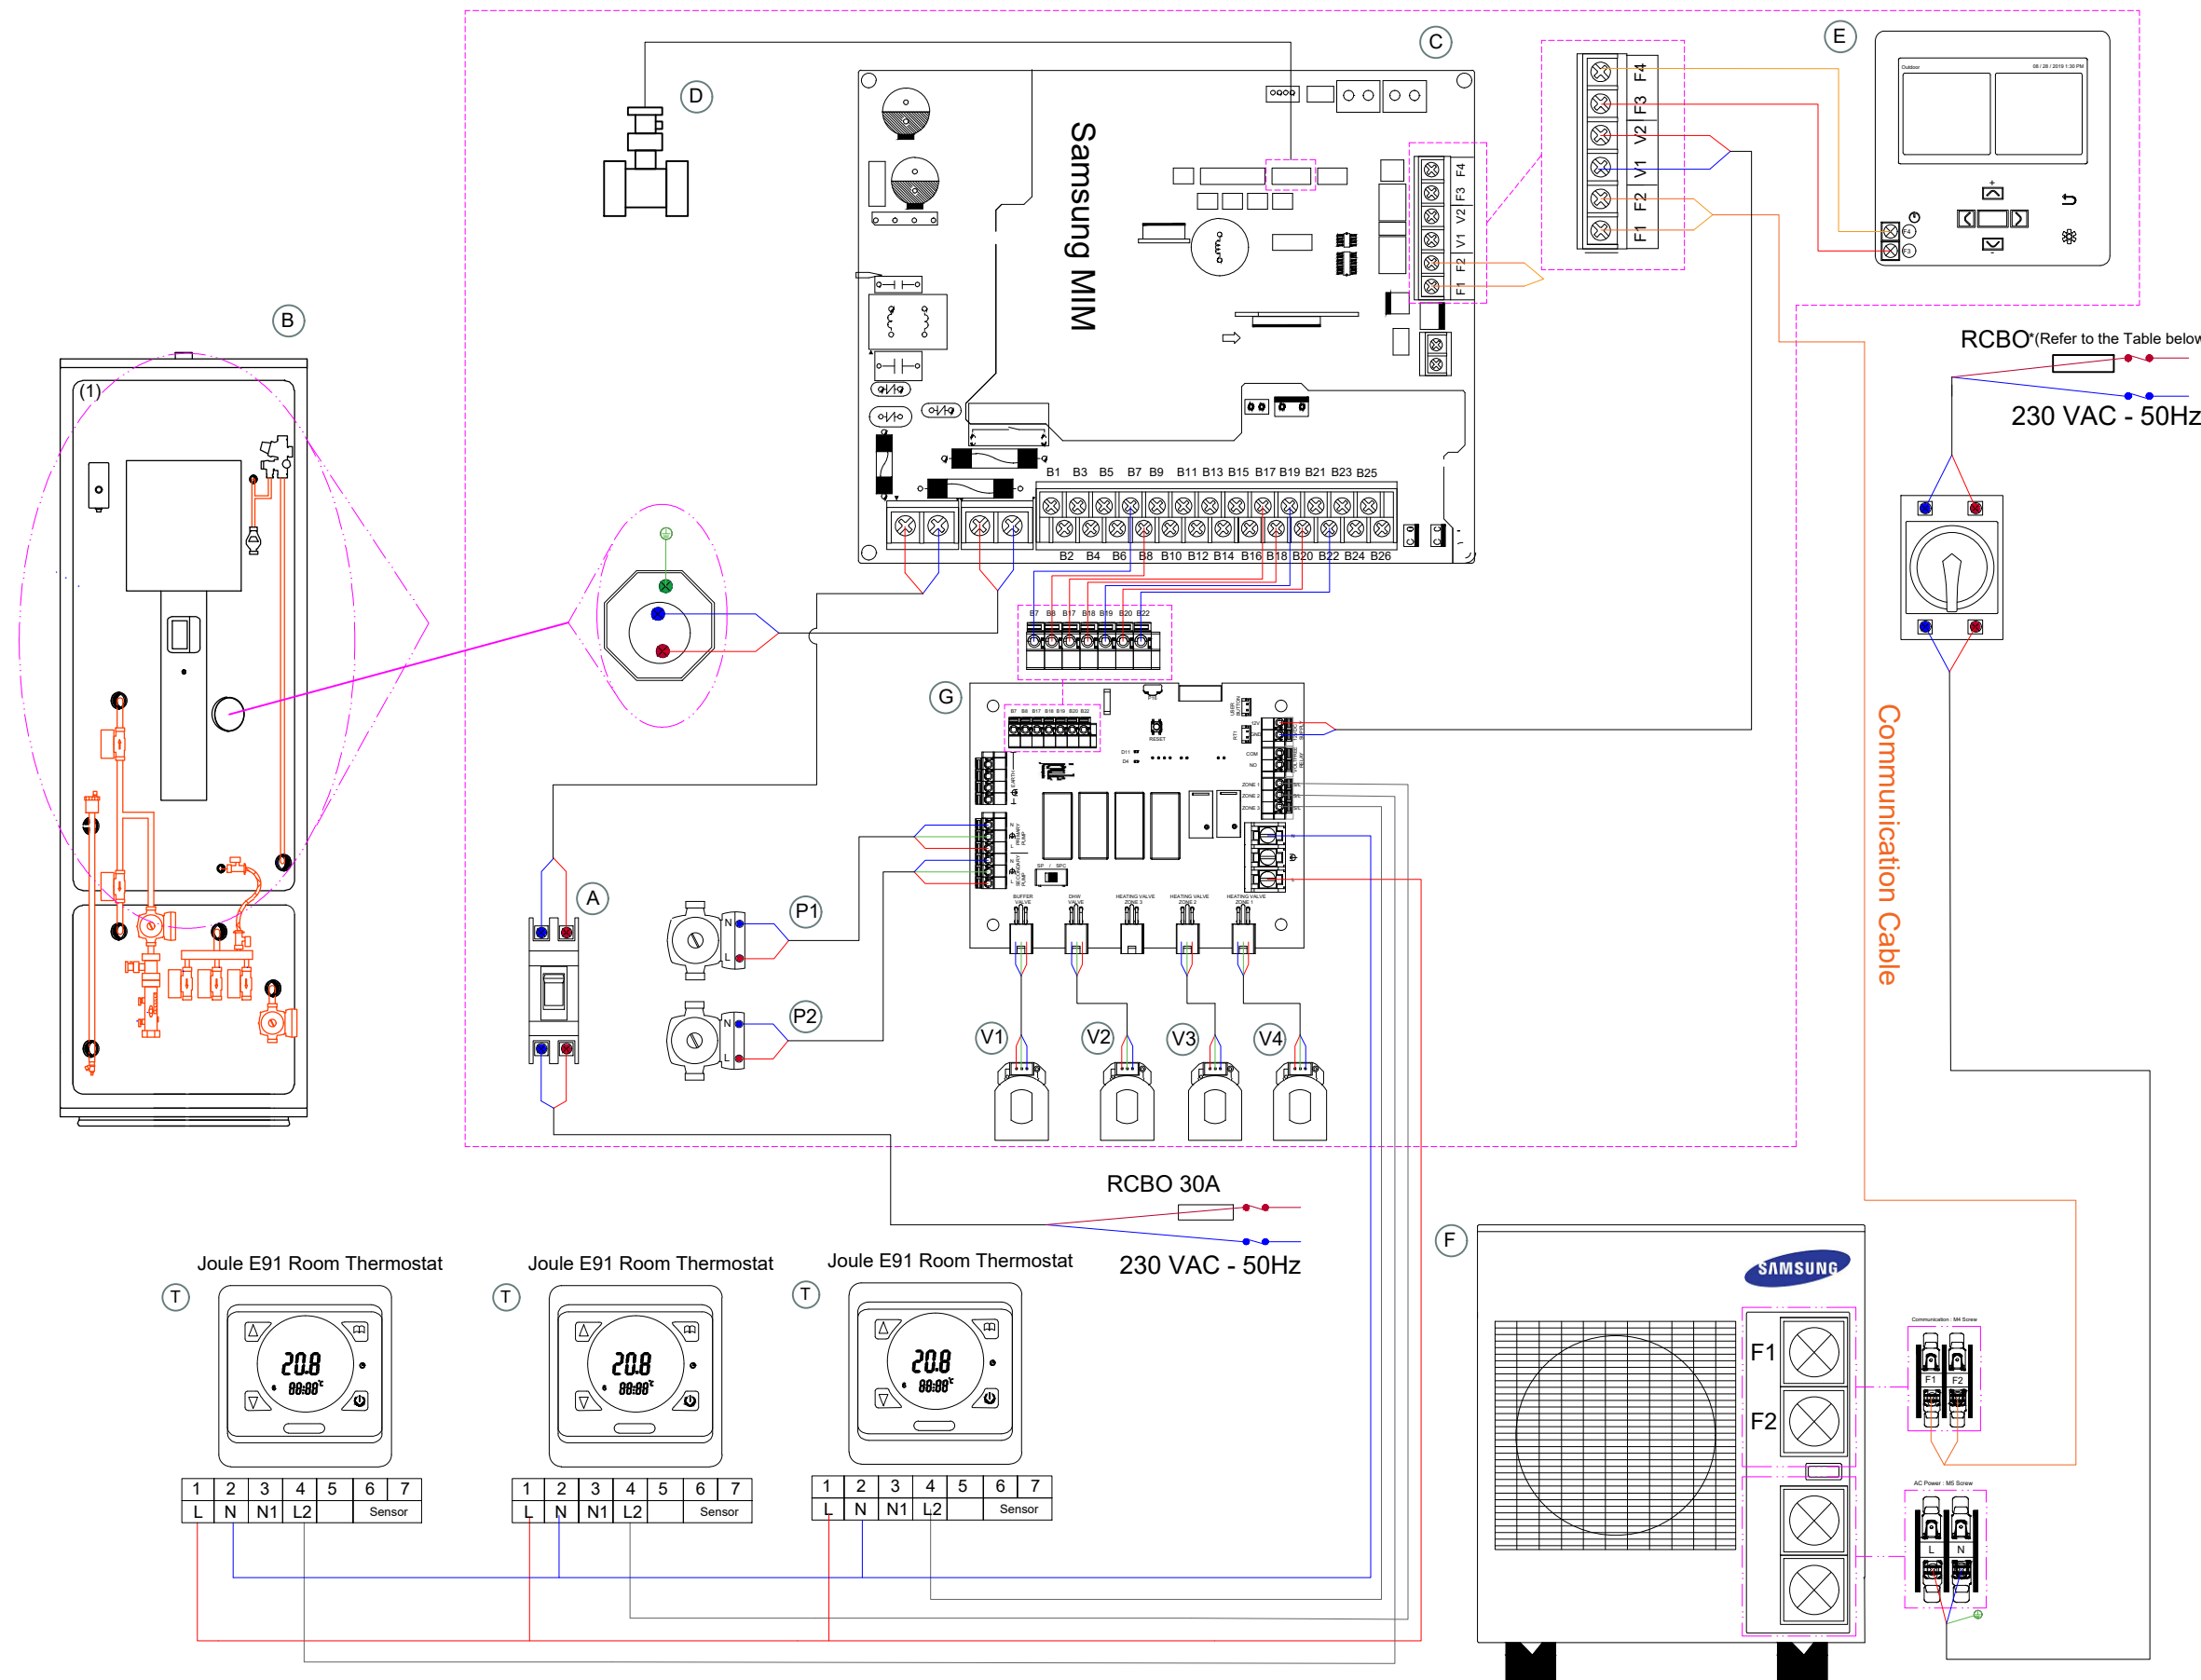

# SAMSUNG ASHP WITH SMARTPLUMB DHW WITH 3 HEATING ZONE 3XRADs

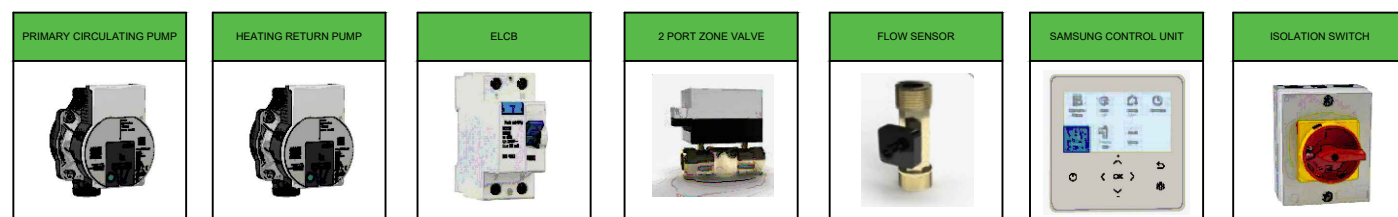

POWER CABLE SPECIFICATIONS			
OUTDOOR UNIT	RATED		MCA RECOMMENDED CIRCUIT AMPS
	Hz	VOLTS	
HHSM-G600005-1	50	220-240	20.0 A
HHSM-G600008-1	50	220-240	20.0 A
HHSM-G600012-1	50	220-240	32.0 A
HHSM-G600016-1	50	220-240	32.0 A